

FM Hazardous Area Approvals

Fisher™ i2P-100 Electro-Pneumatic Transducer

Hazardous Area Classifications and Special Instructions for “Safe Use” and Installation in Hazardous Locations

Certain nameplates may carry more than one approval, and each approval may have unique installation/wiring requirements and/or conditions of “safe use”. These special instructions for “safe use” are in addition to, and may override, the standard installation procedures. Special instructions are listed by approval.

Note

This information supplements the nameplate markings affixed to the product and the i2P-100 instruction manual ([D103198X012](#)), available from your [Emerson sales office](#) or Local Business Partner, or at [www.Fisher.com](#).

Always refer to the nameplate itself to identify the appropriate certification.

⚠ WARNING

Failure to follow these conditions of “safe use” could result in personal injury or property damage from fire or explosion, and area re-classification.

Special Conditions of Use

Intrinsically Safe, Explosion-proof, Type n, Non-incendive, Dust-Ignition proof


1. When product is used with natural gas as the pneumatic medium, the maximum working pressure of the natural gas supply is limited to 50 psi.
2. When product is used with natural gas as the pneumatic medium the product shall be provided with the proper remote venting, as described in the i2P-100 instruction manual (D103198X012).
3. The apparatus enclosure contains aluminum and is considered to constitute a potential risk of ignition by impact or friction. Care must be taken into account during installation and use to prevent impact or friction.

Refer to table 1 for additional information.

Table 1. Additional Approval Information

Certification Body	Certification Obtained	Entity Rating	Temperature Code
FM	IS Intrinsically Safe Class I, II, III Division 1 GP A, B, C, D, E, F, G per drawing GE07470 (see figure 1) Class I Zone 0 AEx ia IIC T3/T4/T5 per drawing GE07470 (see figure 1)	Vmax = 30 VDC Imax = 100 mA Pi = 1.0 W Ci = 0 uF Li = 0 uH	T3 (Tamb ≤ 85°C) T4 (Tamb ≤ 81°C) T5 (Tamb ≤ 46°C)
	XP Explosion Proof Class I, Division 1, GP A, B, C, D T5/T6 Class I Zone 1 AEx d IIC T5/T6 NI Non-incendive Class I, Division 2, GP A, B, C, D T5/T6 Type n Class I, Zone 2 AExn IIC T5/T6 DIP Dust-ignition proof Class II, III Division 1, GP E, F, G T5/T6 S Suitable for Use Class II, III Division 2, GP F, G T5/T6	---	T5 (Tamb ≤ 85°C) T6 (Tamb ≤ 75°C)

Figure 1. FM Loop Schematic (Drawing GE07470)

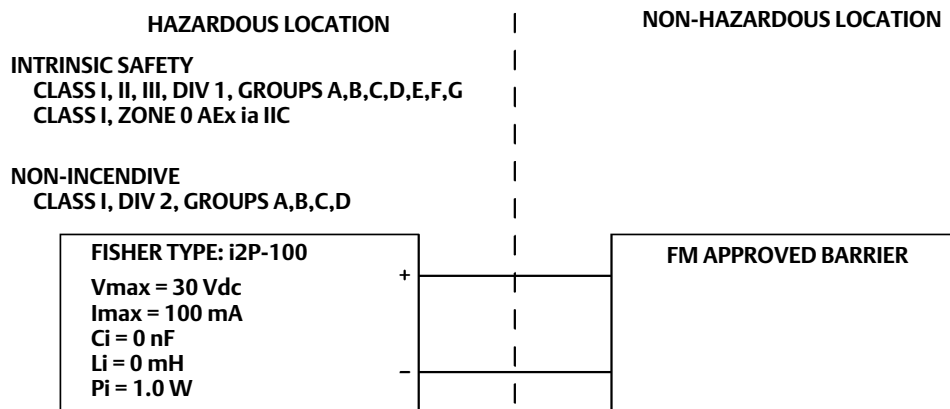

NOTES:

1. THE INSTALLATION MUST BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC), NFPA 70, ARTICLE 504 AND ANSI/ISA RP12.6 OR ARTICLE 505.
2. CLASS 1, DIV 2 APPLICATIONS MUST BE INSTALLED AS SPECIFIED IN NEC ARTICLE 501-4(B). EQUIPMENT AND FIELD WIRING IS NON-INCENDIVE WHEN CONNECTED TO APPROVED BARRIERS WITH ENTITY PARAMETERS.
3. LOOPS MUST BE CONNECTED ACCORDING TO THE BARRIER MANUFACTURER'S INSTRUCTIONS.
4. MAXIMUM SAFE AREA VOLTAGE SHOULD NOT EXCEED 250 Vrms.
5. RESISTANCE BETWEEN BARRIER GROUND AND EARTH GROUND MUST BE LESS THAN ONE OHM.
6. NORMAL OPERATING CONDITIONS 30 Vdc 20 mADC.
7. FOR ENTITY INSTALLATION (I.S. AND N.I.):
 $V_{max} > V_{oc}$, or V_t $C_i + C_{cable} < C_a$
 $I_{max} > I_{sc}$, or I_t $L_i + L_{cable} < L_a$
 $P_i > P_o$, or P_t

WARNING:

THE APPARATUS ENCLOSURE CONTAINS ALUMINUM AND IS CONSIDERED TO CONSTITUTE A POTENTIAL RISK OF IGNITION BY IMPACT OR FRICTION. AVOID IMPACT AND FRICTION DURING INSTALLATION AND USE TO PREVENT RISK OF IGNITION.

Neither Emerson, Emerson Automation Solutions, nor any of their affiliated entities assumes responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use, and maintenance of any product remains solely with the purchaser and end user.

Fisher is a mark owned by one of the companies in the Emerson Automation Solutions business unit of Emerson Electric Co. Emerson Automation Solutions, Emerson, and the Emerson logo are trademarks and service marks of Emerson Electric Co. All other marks are the property of their respective owners.

The contents of this publication are presented for informational purposes only, and while every effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available upon request. We reserve the right to modify or improve the designs or specifications of such products at any time without notice.

Emerson Automation Solutions
Marshalltown, Iowa 50158 USA
Sorocaba, 18087 Brazil
Cernay, 68700 France
Dubai, United Arab Emirates
Singapore 128461 Singapore

www.Fisher.com

