
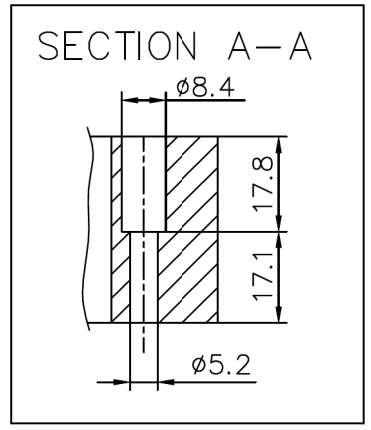
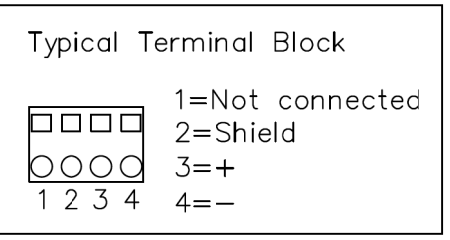


2016-01-25 Electronic Master - Printed Copies Uncontrolled - Emerson Proprietary

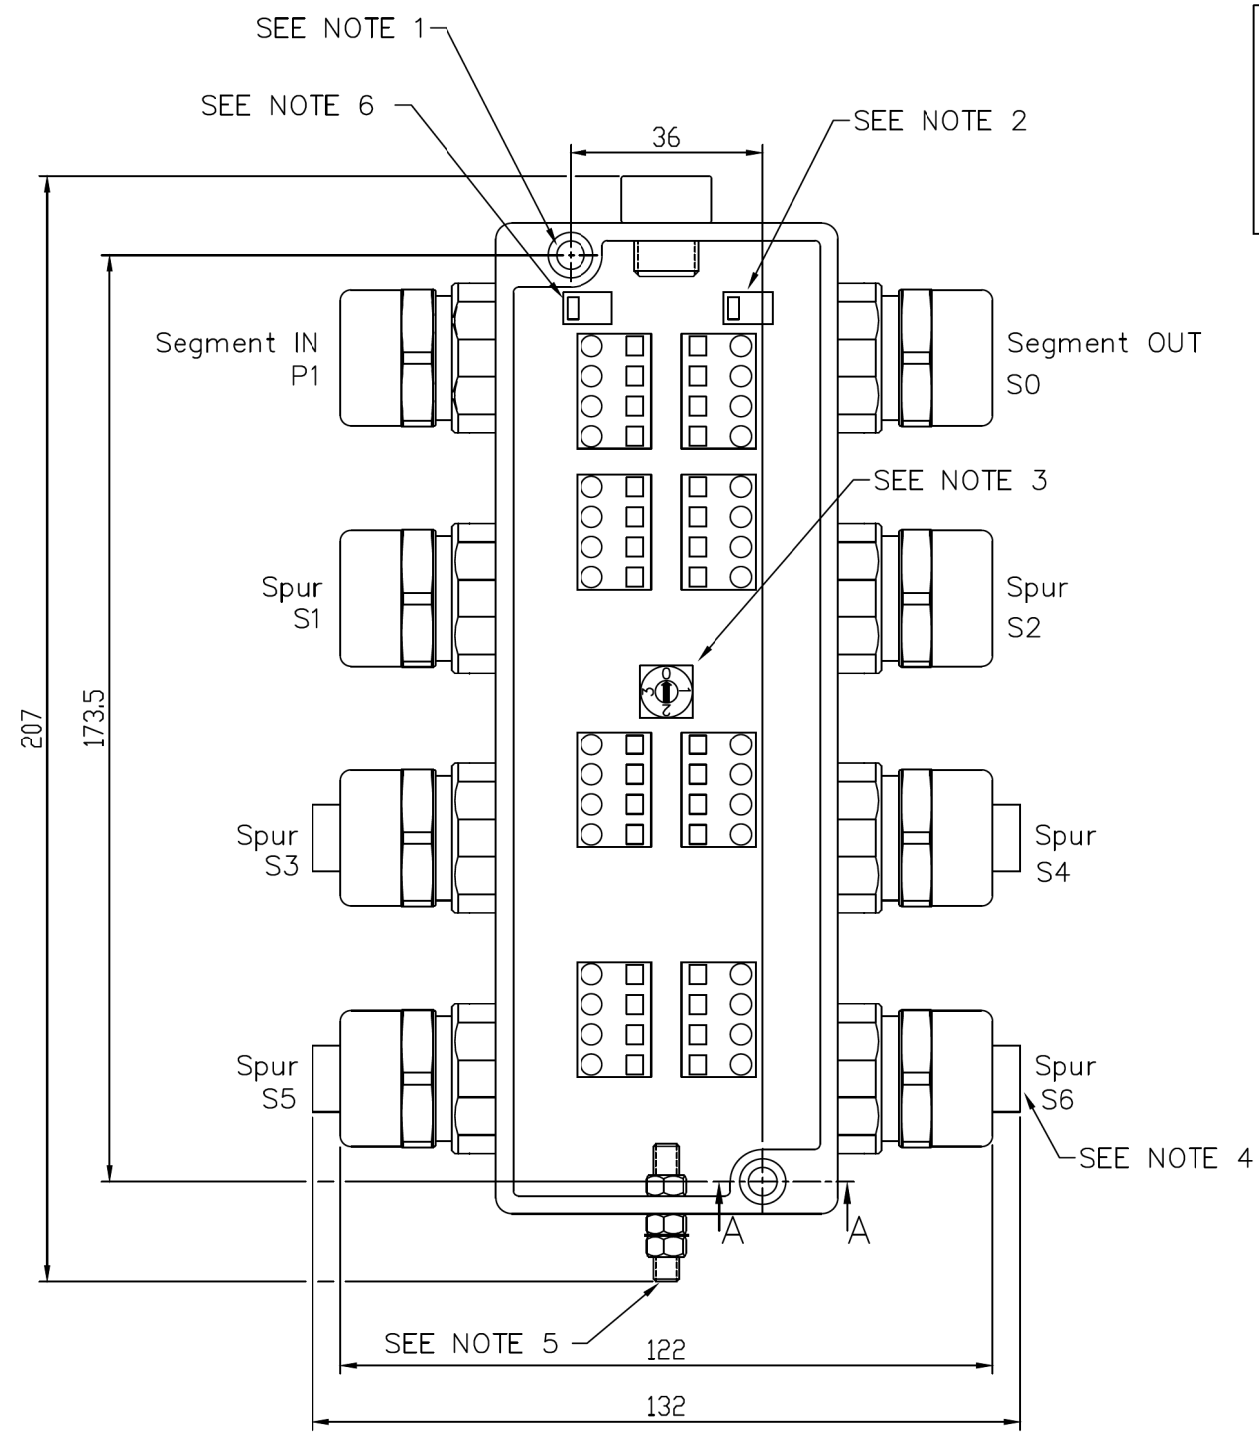

- 6 SWITCH FOR DIRECT COUPLING OF THE SHIELD AND THE HOUSING.
- 5 HOUSING GROUND.
- 4 UNUSED CONDUIT ENTRIES SHALL BE PLUGGED TO PRESERVE PROTECTION CLASS IP67.
- 3 ADJUSTABLE SHORT-CIRCUIT LIMIT. CHOOSE "0" WHEN CONNECTING TO A ROSEMOUNT 5900.
- 2 SELECTABLE BUS TERMINATING RESISTOR.
- 1 MOUNTING HOLES:
HOLE PATTERN 173.5 x 36
FOR SCREW DIMENSION SEE SECTION A-A.

ISSUED BY EMe-BL	WEEK 1553	PRODUCT CODE 5900	FILE ACAD	INSTALLATION DRAWING TITLE ELECTRICAL INSTALLATION DRAWING SEGMENT COUPLER	
APPROVED BY TT-PDI	WEEK 1602	ORIGINAL DWG NO. -	SCALE -	DOC TYPE 02	DWG NO. D7000003-254
ROSEMOUNT Tank Gauging			1 ST ANGLE 	ISSUE 01	SHEET 01/01

THE COPYRIGHT/OWNERSHIP OF THIS DOCUMENT IS AND WILL REMAIN OURS. THE DOCUMENT MUST NOT BE USED WITHOUT OUR AUTHORIZATION OR BROUGHT TO THE KNOWLEDGE OF A THIRD PARTY. CONTRAVENTION WILL BE PROSECUTED. ROSEMOUNT TANK RADAR AB, SWEDEN.